



DETAIL 1: TYPICAL SIDEWALK CONSTRUCTION
NTS

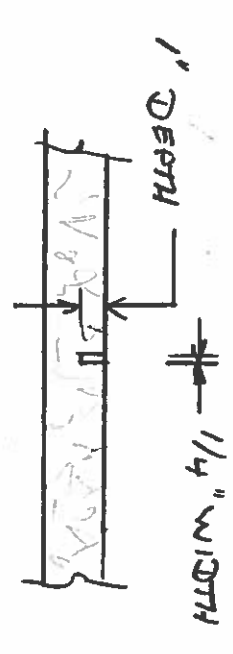

DETAIL 2: TYPICAL CONTROL JOINT (C.J.)
NTS

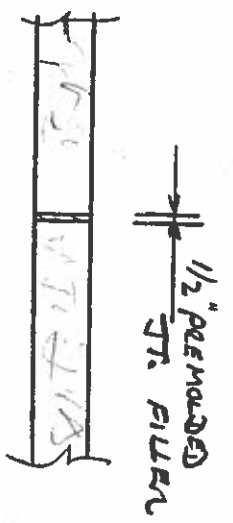

DETAIL 3: TYPICAL EXPANSION JOINT (EX.P.J.)
NTS

NOTES:

1. ALL CONCRETE CONSTRUCTION SHALL CONFORM TO ACI 308 AND ACI 309 LATEST EDITIONS.
2. CONCRETE FOR SIDEWALKS AND ARE ENCASEMENTS SHALL DEVELOP A MINIMUM COMPRESSIVE STRENGTH OF 4000 PSI IN 28 DAYS.
3. CONCRETE USED TO FILL CHANGERS FOR ABANDONMENT SHALL DEVELOP A MINIMUM COMPRESSIVE STRENGTH OF 4000 PSI IN 28 DAYS.

	SK-4.1
	TYPICAL CONCRETE DETAILS & NOTES
THM THOMAS J. LAROCO PROFESSIONAL ENGINEER No. 12,782 STATE OF NEW JERSEY	10/8/21